


NEC 250.70 Methods of Grounding and Bonding Conductor Connection To Electrodes. **Ground clamps shall be listed for the materials of the grounding electrode...**



Made in USA

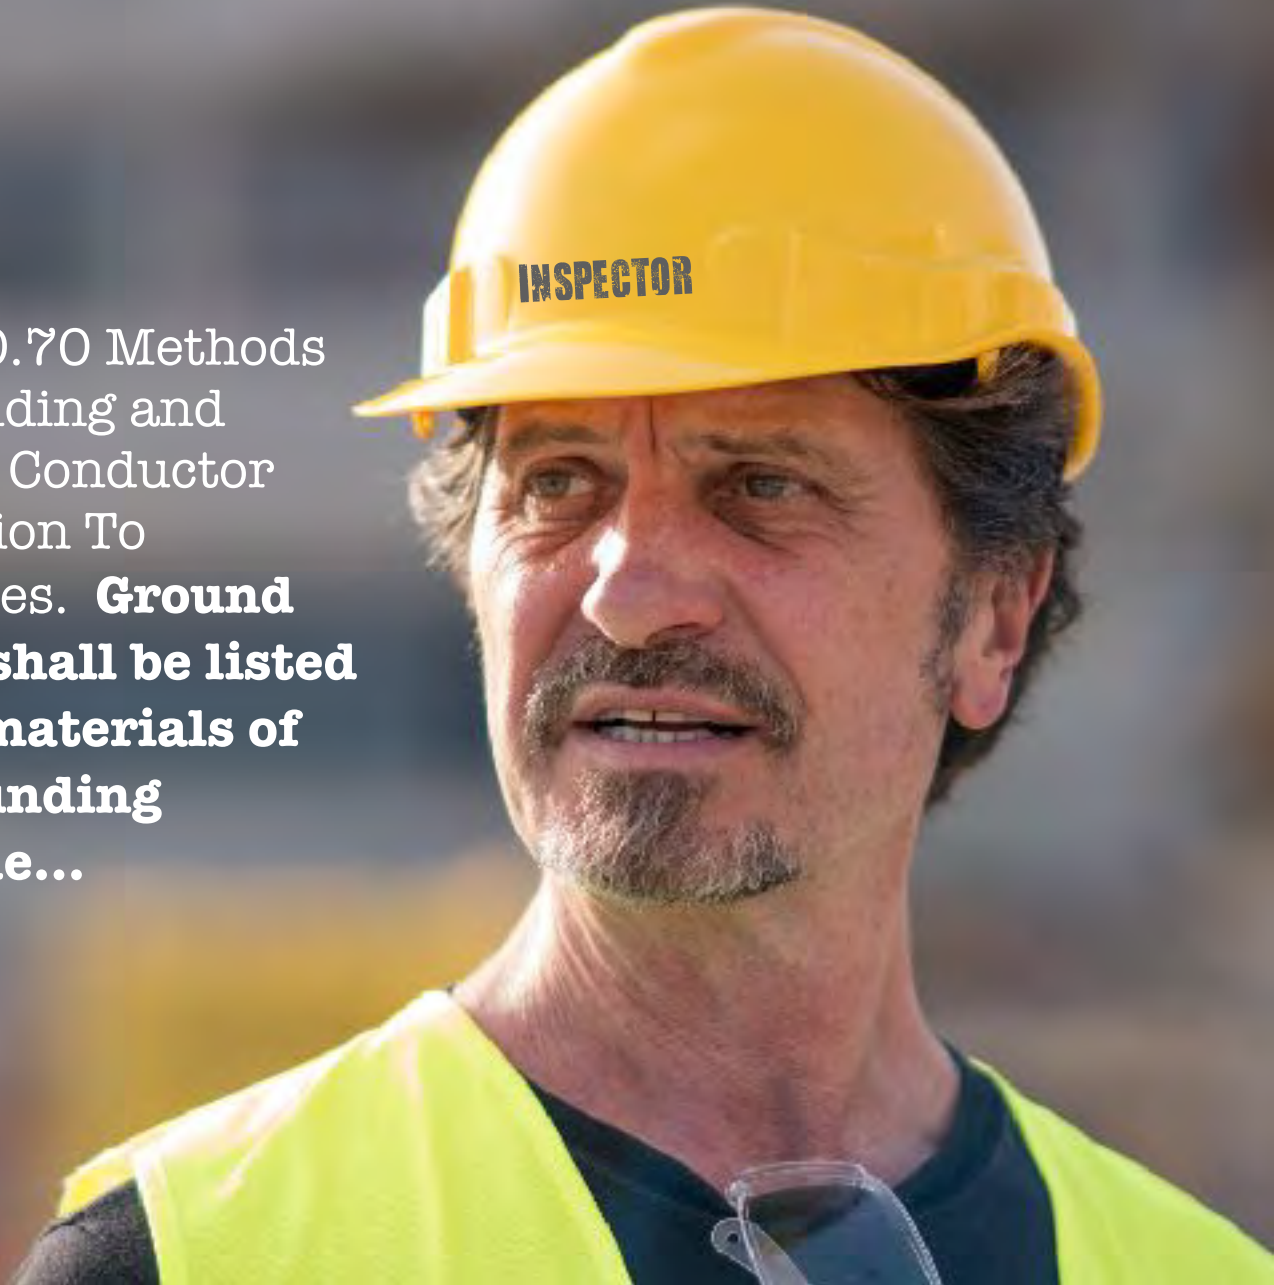

Problem Solved

The problem is that most acorn clamps are only listed for copper coated ground rods. If one of these clamps is installed on a galvanized or stainless steel rod, the installation does not meet code. **Galvan has the solution.**

New US-made Galvan G-5 and SRC grounding clamps are UL listed and marked for copper coated, galvanized and stainless steel ground rods. They are also listed for rebar (UFER) grounds. How do you know? Because it's stamped right in the casting. Galvan delivers the clamps that make grounding code compliant to NEC 250.70. Problem solved.

Galvan Industries, Inc.
www.galvanelectrical.com • 704-455-5102

